


PWR – Power supply 230VAC/50Hz, according to applicable standards (16A circuit breaker, 30mA RCD for Barrier and terminal (CYKY 3Cx2.5))

ETH – Subnetwork according to applicable standards (IEEE Standard for Ethernet / IEEE 802.3-2012)

All wiring to be led through the centre of foundation kits.
Use electrical conduits for wiring protection.
Free ends to be minimum 2m long.

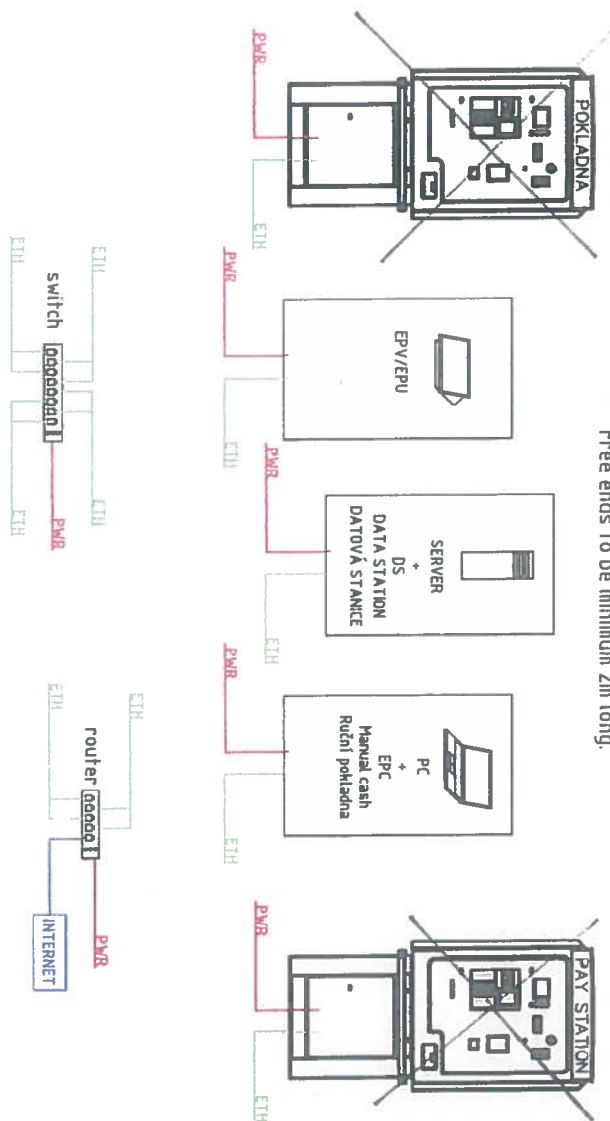

PWR – Napájení 230/50Hz, dle platných norem (16A jistič, 30mA proudový chránič pro závoru a stojan (CYKY 3Cx2.5))

ETH – Stejná počítačová síť dle platných norem (IEEE Standard for Ethernet / IEEE 802.3-2012)

Všechny kabely vedte středem kotevnicí sad.
Kabely vedeny v příslušných kabelových chráničích.
Délka volných konců kabelů u kotevnicí sady musí být cca 2m.